


SCHWINGGESCHWINDIGKEIT

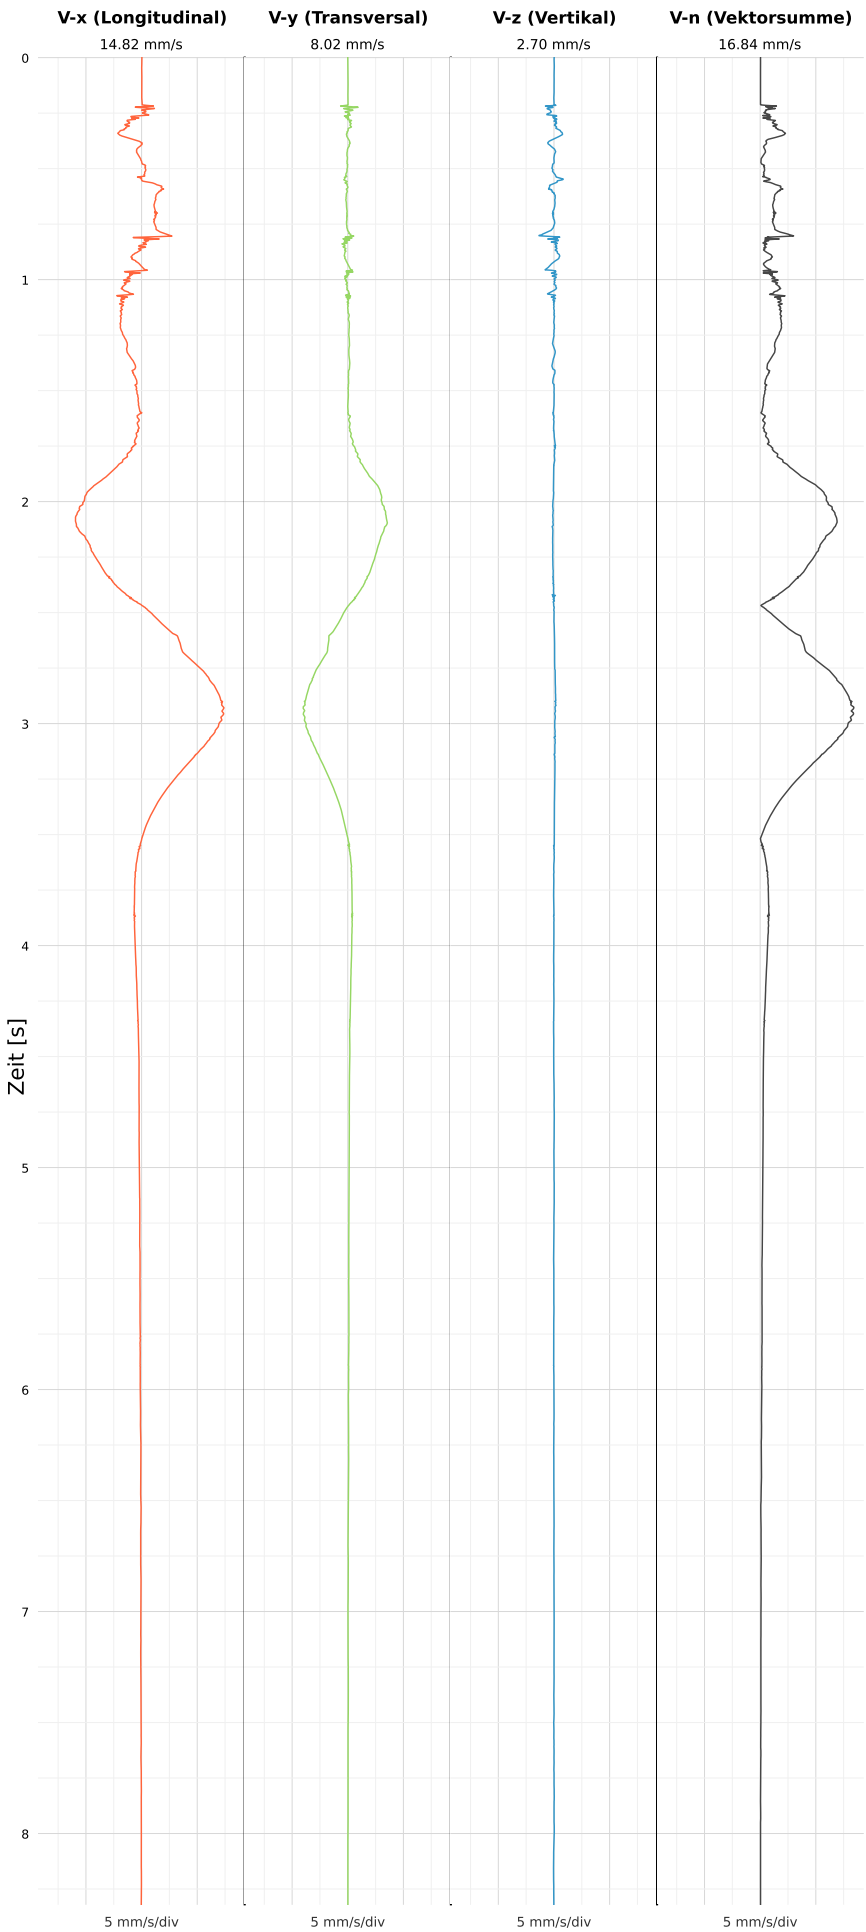

DATEI: 2496-HF15-26202006-210225_raw.csv

Aufzeichnungsdauer: 8.32 s | Abtastrate: 1000 Hz

Datum:	20.06.2026
Zeit:	21:02:25
Event-ID:	2496-HF15-26202006-210225
Kalibrier Datum:	10.07.2025
Spitzwerte	
V-x (Longitudinal)	V-y (Transversal)
14.82 mm/s	8.02 mm/s
0.4 Hz	0.5 Hz
296.38% von Limit	160.30% von Limit
V-z (Vertikal)	
2.70 mm/s	0.5 Hz
53.97% von Limit	
V-n (Vektorsumme): 16.84 mm/s	

